



164



164

1861

GE
g / SD
H=6.00m
GRZ 0,85
SD

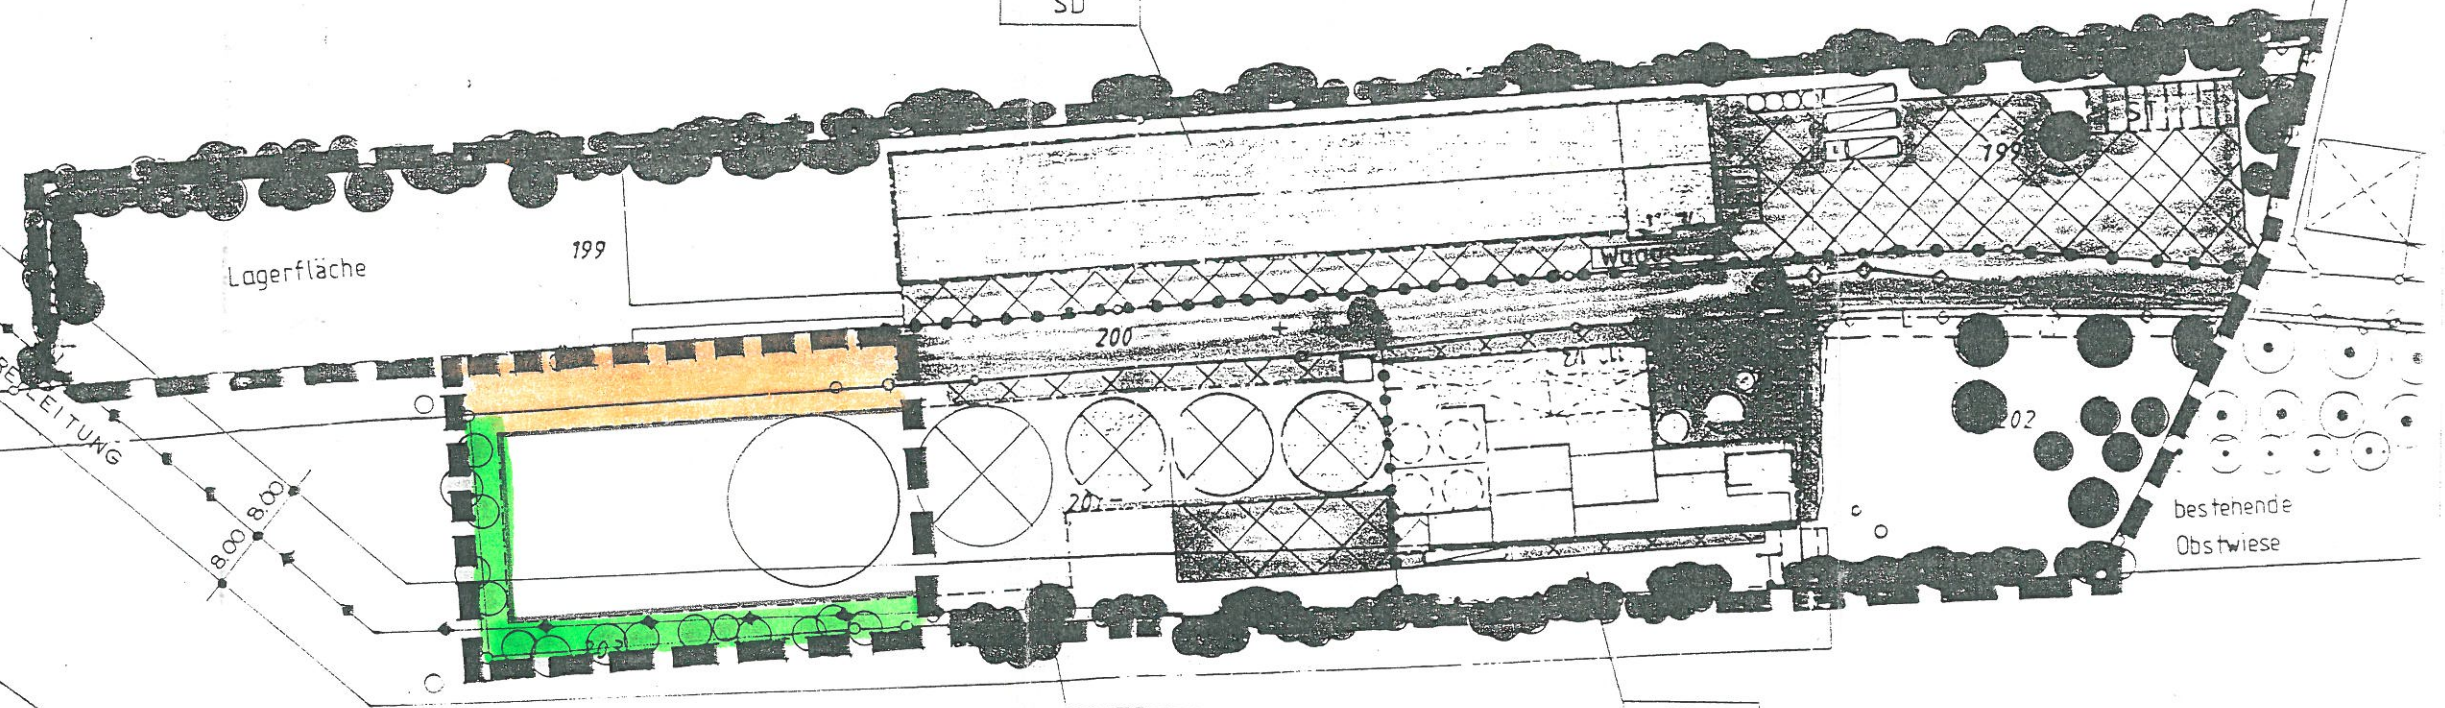

20 KV-FREILEITUNG

Lagerfläche

199

200

201

202

bestehende
Obstwiese

450

KS = 30,00 m

GE
C
KS 15,00m
GRZ 0,80
KE

GE
C
H=10,00m
GRZ 0,80
SC od FD

H = 30,00 m